


GROUP G

LIQUID COOLED INSTALLATION

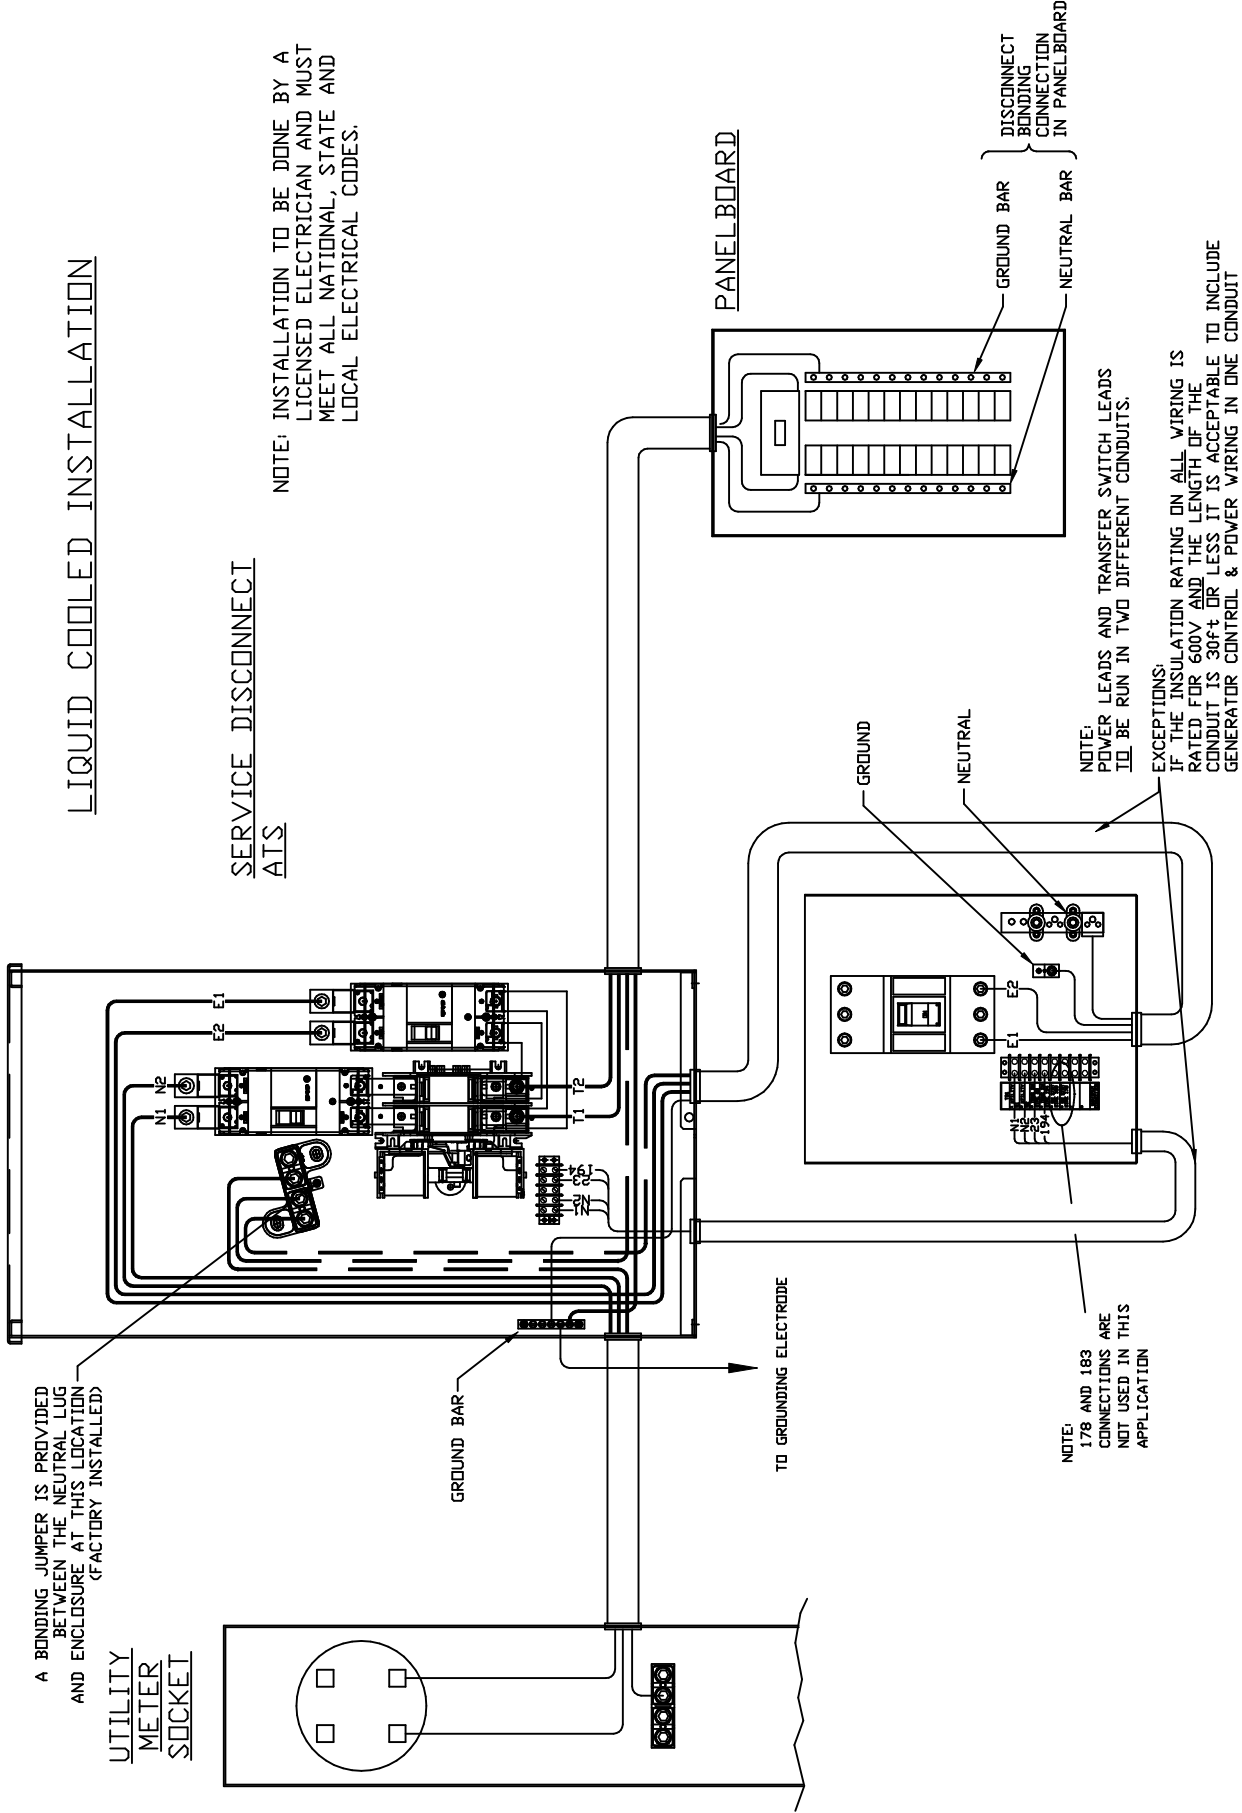

SERVICE DISCONNECT ATS

NOTE: INSTALLATION TO BE DONE BY A LICENSED ELECTRICIAN AND MUST MEET ALL NATIONAL, STATE AND LOCAL ELECTRICAL CODES.

A BONDING JUMPER IS PROVIDED BETWEEN THE NEUTRAL LUG AND ENCLOSURE AT THIS LOCATION (FACTORY INSTALLED)

UTILITY METER SOCKET

GROUND BAR

TO GROUNDING ELECTRODE

PANELBOARD

GROUND BAR
NEUTRAL BAR

DISCONNECT BONDING CONNECTION IN PANELBOARD

NOTE: POWER LEADS AND TRANSFER SWITCH LEADS TO BE RUN IN TWO DIFFERENT CONDUITS.

EXCEPTIONS: IF THE INSULATION RATING ON ALL WIRING IS RATED FOR 600V AND THE LENGTH OF THE CONDUIT IS 30ft+ OR LESS IT IS ACCEPTABLE TO INCLUDE GENERATOR CONTROL & POWER WIRING IN ONE CONDUIT

NOTE: 178 AND 183 CONNECTIONS ARE NOT USED IN THIS APPLICATION

Q.T. SERIES ENGINE GENERATOR CONNECTION PANEL

EXPLODED VIEW:
RTS XFER SW INTERCONNECTIONS
DRAWING #: 0G6788

REVISION: H-2100-B
DATE: 4/21/08

EXPLODED VIEW: RTS XFER SW INTERCONNECTIONS

DRAWING #: 0G6788

APPLICABLE TO:

GROUP G

THIS PAGE IS LEFT INTENTIONALLY BLANK